

Input Parameters

NOMINAL INPUT VOLTAGE RANGE	94.4 - 240VAC or 133VDC-328VDC
MAX. INPUT VOLTAGE RANGE	85-264VAC or 120-360VDC
INPUT FREQUENCY	47-63Hz
MAXIMUM INPUT CURRENT	16 AMPS or 11 AMPS DC
INRUSH CURRENT	<50 AMPS

Output Parameters

Adjustment and Derating.

- The Alpha 800 series is designed to provide a max output power of 800W at nominal output volt-ages. The following procedure must be used to ensure the PSU is operated within its ratings:
- a Calculate the user for power for each module (Volts x Amps).
 - b Total power for slots 1-3 must be ≤600W. Total power for slots 4-7 must be ≤ 600W. Total power (slots 1-7) not exceeding value stipulated in Table 1 above (input depend ant).
 - c Calculate user ampere turns (Amps x turns) for each module.
 - d Add total ampere turns: Slots 1-3 ≤120. Slots 4-7 ≤120. Total of slots 1-7 ≤ 200AT.

Modules	Note	Output Range (*11)	Current	Slots	Turns	Max Current Limit	Settings for hazardous energy
A		4.5-5.5V	60A	2	1	79.2A	>3V
AA		4.5-6.2V	60A	2	1	79.2A	>3V
AL		4.95-5.05V	60A	2	1	79.2A	.>3V
B	1	4.5-5.5V	25A	1	1	33A	-
BB	1	4.5-6.5V	25A	1	1	33A	-
C	4,6,9	5-16V	16A	1	2	21.2A	>11.3V
CM	4,9	5.2-6.6V	16A	1	2	21.2A	-
CL	4,9	4.75-5.3V	16A	1	2	21.2A	-
CH	4,6,9	11.9-12.7V	16A	1	2	21.2A	>11.3V
D	2,9	18-29V	8A	1	4	10-6A	>22.6V
E	2	5-16V	8A	1	2	10.6A	-
		5-16V	8A		2	10.6A	-
EB		4.5-5.5V	9A	1	1	11.9V	-
		4.5-5.5V	9A		1	11.9V	-
EH		11.9-12.7V	8A	1	2	10.6A	-
		11.9-12.7V	8A		2	10.6A	-
EL		5.2-6.6V	8A	1	2	10.6A	-
		11.9-12.7V	8A		2	10.6A	-
EQ		4.5-5.5V	9A	1	1	11.9A	-
		2.7-3.9V	9A		1	11.9A	-
F	9	9-16V	33A	2	2	43.6A	>5.5V
G	3,9	17.5-29V	25A	2	4	33A	>7.2V
H	8	18-32V	5A	1	4	6.6A	-
		18-32V	5A		4	6.6A	-
J	7,9,10	30-48V	10A	2	4(16)	13A	>18.4
K	9	18-29V	15A	2	4	19.8A	>12V
L	1,9	1.8-3.2V	25A	1	1	33A	-
M	9	5-16V	8A	1	2	10.6A	-
N	8,9	18-32V	5A	1	4	6.6V	-

Modules	Note	Output Range	Current	Slots	Turns	Max current limit	Settings for hazardous energy
P		18-29V	5A		4	6.6A	-
		5-16V	8A		2	10.6A	-
PL		23.6-24.5V	5A	1	4	6.6A	-
		4.75-5.3V	8A		2	10.6A	-
Q	1,9	2.7-3.9V	25A	1	1	33A	-
R	9	2.7-3.9V	60A	2	1	79.2A	>3V
S	5,9	2.5-5.7V	85A	2	1	110.5A	>2.2V
T	9	1.8-3.2V	60A	2	1	79.2A	>3V
U	9	10-21V	16A	1	3	21.2A	>11.3
W		4.5-5.5V	15A	1	1	19.8A	-
Z	1	4.5-5.5V	25A	1	1	33A	-

Module Limitations

- 1 For B, BB, Q, L and Z modules in slot 7, max output current is 15A.
- 2 For D and E modules in slot 7, max output current is 5A
- 3 For G modules in slot 6 & 7, max output current is 15A.
- 4 For C, CH, CL, CM modules in slot 7, max output current is 10A.
- 5 For S modules in slots 5 and 6 max output current is 77A and in slots 6 and 7 max output current is 67A.
- 6 For C and CH modules the max output current is 12A for output voltages > 12V.
- 7 For J modules the output current derates linearly by 0.25A per volt above 40V.
- 8 For H and N modules with output > 29V, max output current is 1A .
- 9 When using remote sense, the max output voltage will be reduced by 0.5V for L, S, T, Q and R modules, and by 1.0V for C, CH, CL, CM, D, F, G, J, M, K, N, U Modules.
- 10 Ampere turns for J module is calculated as AT=(output current + 15A) x 4.
- 11 Adjusting output voltage beyond the stated range may cause overvoltage protection (OVP) to operate, whereby all outputs will turn off. To reset OVP, turn back output voltage adjustment and remove the mains supply fpr 30 seconds.

Unit Limitations

Input Voltage	Maximum Peak Output Power	Maximum Continuous Output Power
120 - 360 VDC	1000W for 30 seconds maximum followed by 800W for 60 seconds minimum	800W
85 - 150 VAC	1000W for 30 seconds maximum followed by 800W for 60 seconds minimum	800W
150 - 264 VAC	N/A	1000W

Important safety Instructions

Servicing

These products are not customer serviceable. Repairs may only be carried out by TDK-Lambda Limited or their authorised agents. These products are not authorised for use as critical components in nuclear control systems, life support systems or equipment for use in hazardous environments without the express written approval of the Managing Director of TDK-Lambda Limited.

Energy Hazards and SELV

Certain modules are capable of providing hazardous energy (240VA) according to output voltage set-ting. Final equipment manufacturers must provide protection to service personnel against inadvertent contact with these module output terminals. If set such that hazardous energy can occur then the module terminals or connections must not be user accessible.

Approval Limitations: Use in North America (AC units only)

When this product is used on 180VAC-250VAC mains with no neutral, connect the two live wires to L(live) and N (neutral) terminals on the input connector. In this instance double pole fusing is required.

High Voltage Warning

Dangerous voltages present within the power supply. Do not remove covers.

External Hot Surfaces

Section 6 of the Health and Safety at Work Act requires that manufacturers have an obligation to protect service engineers as well as users. In order to comply with this, a label must be fitted to these products which is clearly visible to service personnel accessing the overall equipment, and which legibly warns that surfaces of these products may be hot and must not be touched when the products are in operation

Safety Earthing Screw

On products with an enclosure, special safety earthing screws are used which connect the cover to the chassis. They must not be removed.

Safety Class of Protection

These products are designed for the following parameters : Material Group IIIB, Pollution Degree 2, Overvoltage Category II, Class 1 (earthed), Indoor use as part of an overall equipment such that the product is accessible to service engineers only.

Safety approvals

UL60950-1 and CSA22.2 No 60950-1 - UL Recognised. C-UL for Canada.
IEC/EN60950-1 - CE mark. CE marking when applied to any Alpha product, indicates compliance with the Low Voltage Directive (2006/95/EC) in that it complies with EN60950-1
UL/CSA60601-1 UL Recognised. C-UL for Canada.(For LL, RL and TL filters only)

Symbols



Input markings



Environmental parameters

Operation
Temperature 0 to 50°C for AC input(derating 2.5%°C above 50°C to 65°C -Not covered by approvals).0-45°C.for DC input (derating 2.5% per °C above 45°C to 65°C - Not covered by approvals.
Humidity 5 to 95% RH non-condensing. Air Pressure 70kPa to 106kPa.
Altitude -200m to 3000m
Storage and Transportation
Temperature -40°C to +85°C. Humidity 5% to 95% RH non-condensing.
Air Pressure 54kpa to 106kpa. Altitude -200m to 5000m.
Vibration and shock
10-200Hz @ 1.5G sinewave, 20G for 15 minutes in 3 axes random vibration / 3000 bumps, 10G (16mS) half sinewave.
Cooling
These units may be mounted in any of 4 orientations: Horizontal, on either side or vertical with airflow upwards. The airflow around the power supply air inlets and outlets must not be impeded when it is fitted in the end use application..

Level of insulation

Dielectric Strength testing is carried out as follows:
Primary mains circuit to earth - 2.25 - 2.35kVDC
Primary mains circuits to transformer core - 4.25 - 4.35kVDC*
Primary mains circuits to secondary -4.25 - 4.35kVDC.*
Outputs to each other and to earth are isolated to 500VDC.
*This test is not possible with modules fitted to the unit as damage to RFI capacitors will occur)

EMC performance

Emissions :
EN55022 Conducted RFI-Class A or B (depending on product - Consult Technical Sales).
Radiated RFI - Class A
EN61000-3-2 / A14 - Pass - Class A and D. EN61000-3-3 / A1 - Pass
Immunity:
EN61000-4-2 - Level 4 Criteria B EN61000-4-3 - Level 3 Criteria B
EN61000-4-4 - Level 4 Criteria B EN61000-4-5 - Level 3 Criteria B (Installation Class 3, Criteria B)
EN61000-4-6 - Level 3 Criteria B EN61000-4-11 - Pass VDE 0160 - Class 2 (Clause 7.3.1.1.)

General installation instructions

The Alpha family of component power supplies is designed for use within other equipment or enclosures which restrict access to authorised competent personnel only. For safe installation and operation of this product, carefully follow the instructions listed below:
i) The unit covers/chassis are designed to protect only skilled personnel from hazards and must not be made user accessible.
ii) These products are Class 1 and must therefore be reliably earthed and professionally installed in accordance with the prevailing electrical wiring regulations and the safety standards covered herein.
iii) These products are IPX0 and chemicals/solvents, cleaning agents and other liquids must not be used.

Special Instructions for medical applications (IEC/EN/UL/CSA60601-1)

Applicable to products with LL, RL and TL filter options only.
i) These products are designed for continuous operation within an overall enclosure, and must be mounted such that access to the mains terminals is restricted. (Clause 16, IEC/EN/UL/CSA60601-1)
ii) These products are NOT suitable for use in the presence of flammable anaesthetic mixtures with air or with oxygen or with nitrous oxide.
iii) These products are ordinary equipment and are NOT protected against the ingress of water.
iv) Connect only apparatus complying with IEC/EN/UL/CSA60601-1, to the signal ports.
v) Except for permanently installed equipment as defined in Clause 57.6 of IEC/EN/UL/CSA60601-1, the overall equipment in which these products are installed must have double pole fusing on the input mains supply or DC supply as appropriate. The products themselves have single pole fusing in the live line or positive DC line as appropriate.
vi) Reference should be made to local regulations concerning the disposal of these products at the end of their useful life.

Mechanical parameters

DO NOT USE MOUNTING SCREWS WHICH PENETRATE THE UNIT BY MORE THAN 4.5 MM.
Weight 3 Kg dependent upon configuration.

Connection details

Input Connections

Mating input faston connectors				
Brand	Colour	Wire size (awg)	Part number	Current rating
Amp	Red	22 - 18	2-520407-2	15A
Amp	Blue	16 - 14	3-520408-2	15A


Input tabs - 6.3mm x 0.8mm, tin plated brass, rated 15A.
Internal fuse (FS101) 6.3 x 32mm, F20AH/250V.

Output Connections


Output Connector Ratings:

- 1) 6.35mm fastons are rated at 15A.
- 2) 9.5mm Faston terminals are rated at 32A (Tab thickness = 1.0mm, suitable Faston terminals are AMP 151667-2 or AMP 280223-2
- 3) M5 screw terminals are rated at 100A subject to the wire and wire connector used to connect them. Maximum recommended torque setting for M5 screws is 2.5 - 3.0Nm.


S1 connector for single output modules

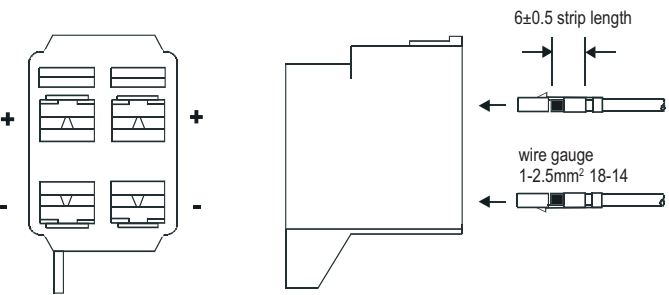

S2 connector for single output modules

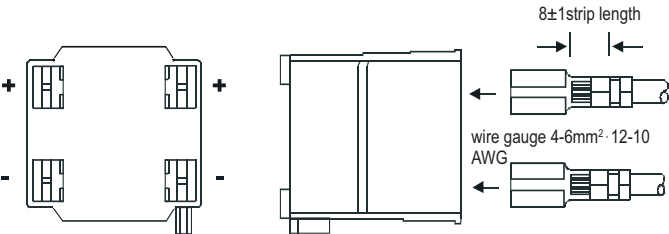


D1 connector for dual output modules

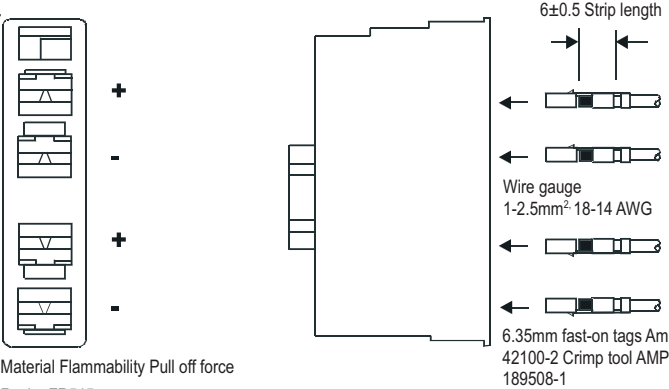

Option: Mains fail options (MF, MFL, MFE, MFU, MFV)


Connector: Six way Molex, 50-37-5063. Crimp terminals: 08-70-1040.

	MF/MFL	MFE	MFU	MFV
Pin 1	Inhibit Low	Enable Low	Inhibit Low	Inhibit Low
Pin 2	+5V Aux	+5V Aux	+5V Aux	+5V Aux
Pin 3	Power Fail	Power Fail	Power Fail Emitter	AC Fail
Pin 4	0V Aux	0V Aux	0V Aux	0V Aux
Pin 5	Inhibit High	Enable High	Inhibit High	Inhibit High
Pin 6	NC	NC	Power Fail Collector	SYS Reset



Option: PP - Parallel

Connector: Six way Molex, 90142-0006. Crimp terminals: 90119-2109.

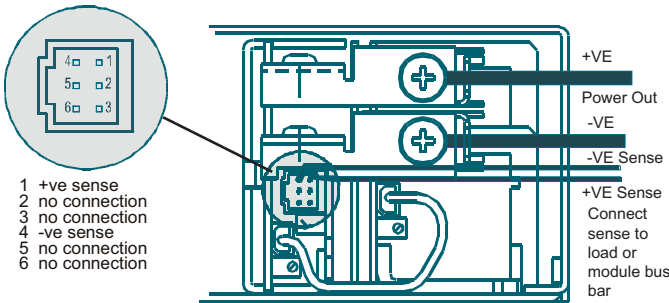

Option: PA - Parallel

Connector:
Six way Molex, 90142-0006.
Crimp terminals: 90119-2109.

Option: IN - Inhibit

Connector:
Six way Molex, 90142-0006.
Crimp terminals: 90119-2109.

1	+ve sense	1	Not connected
2	Module Good	2	Module Good
3	Star Point	3	Inhibit Input
4	-ve sense	4	Not connected
5	-ve power	5	-ve O/P
6	Star Point	6	-ve O/P


Module good adjustment pot
Module good link (J3)

Option: RP - Remote Programming


1	+ve sense	1	Not connected
2	-ve sense	2	Not connected
3	Control 2	3	Not connected
4	NC	4	Not connected
5	Control 1	5	Not connected
6	NC	6	Not connected

For other options refer to application notes


Sense connector SINGLE Width
Single Output Modules




Sense connector DUAL Width
Single Output Modules



AC Connector

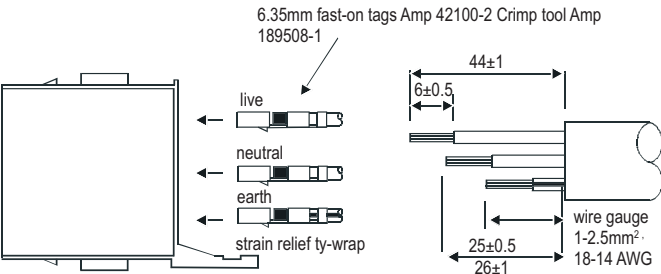

Customer fixings:

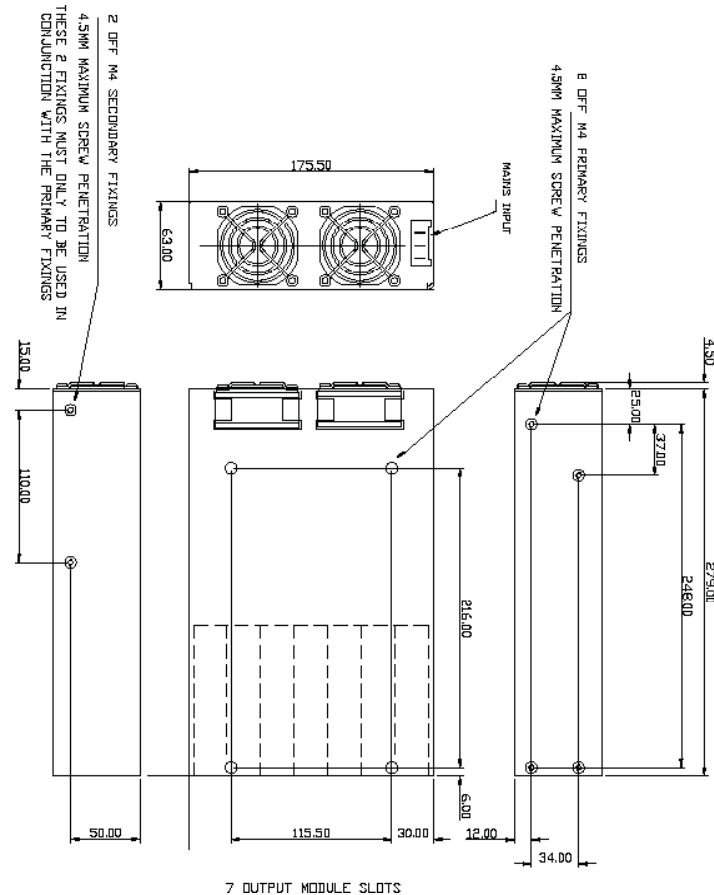

Part No 17026 Issue 13 October 2007
TDK-Lambda UK Limited,
Kingsley Avenue,
Ilfracombe,
Devon. EX34 8ES.
Telephone - Sales and Service (01271) 856666
Head Office and Works (01271) 856600
Facsimile (01271)864894
WEBSITE: www.uk.tdk-lambda.com